KE007

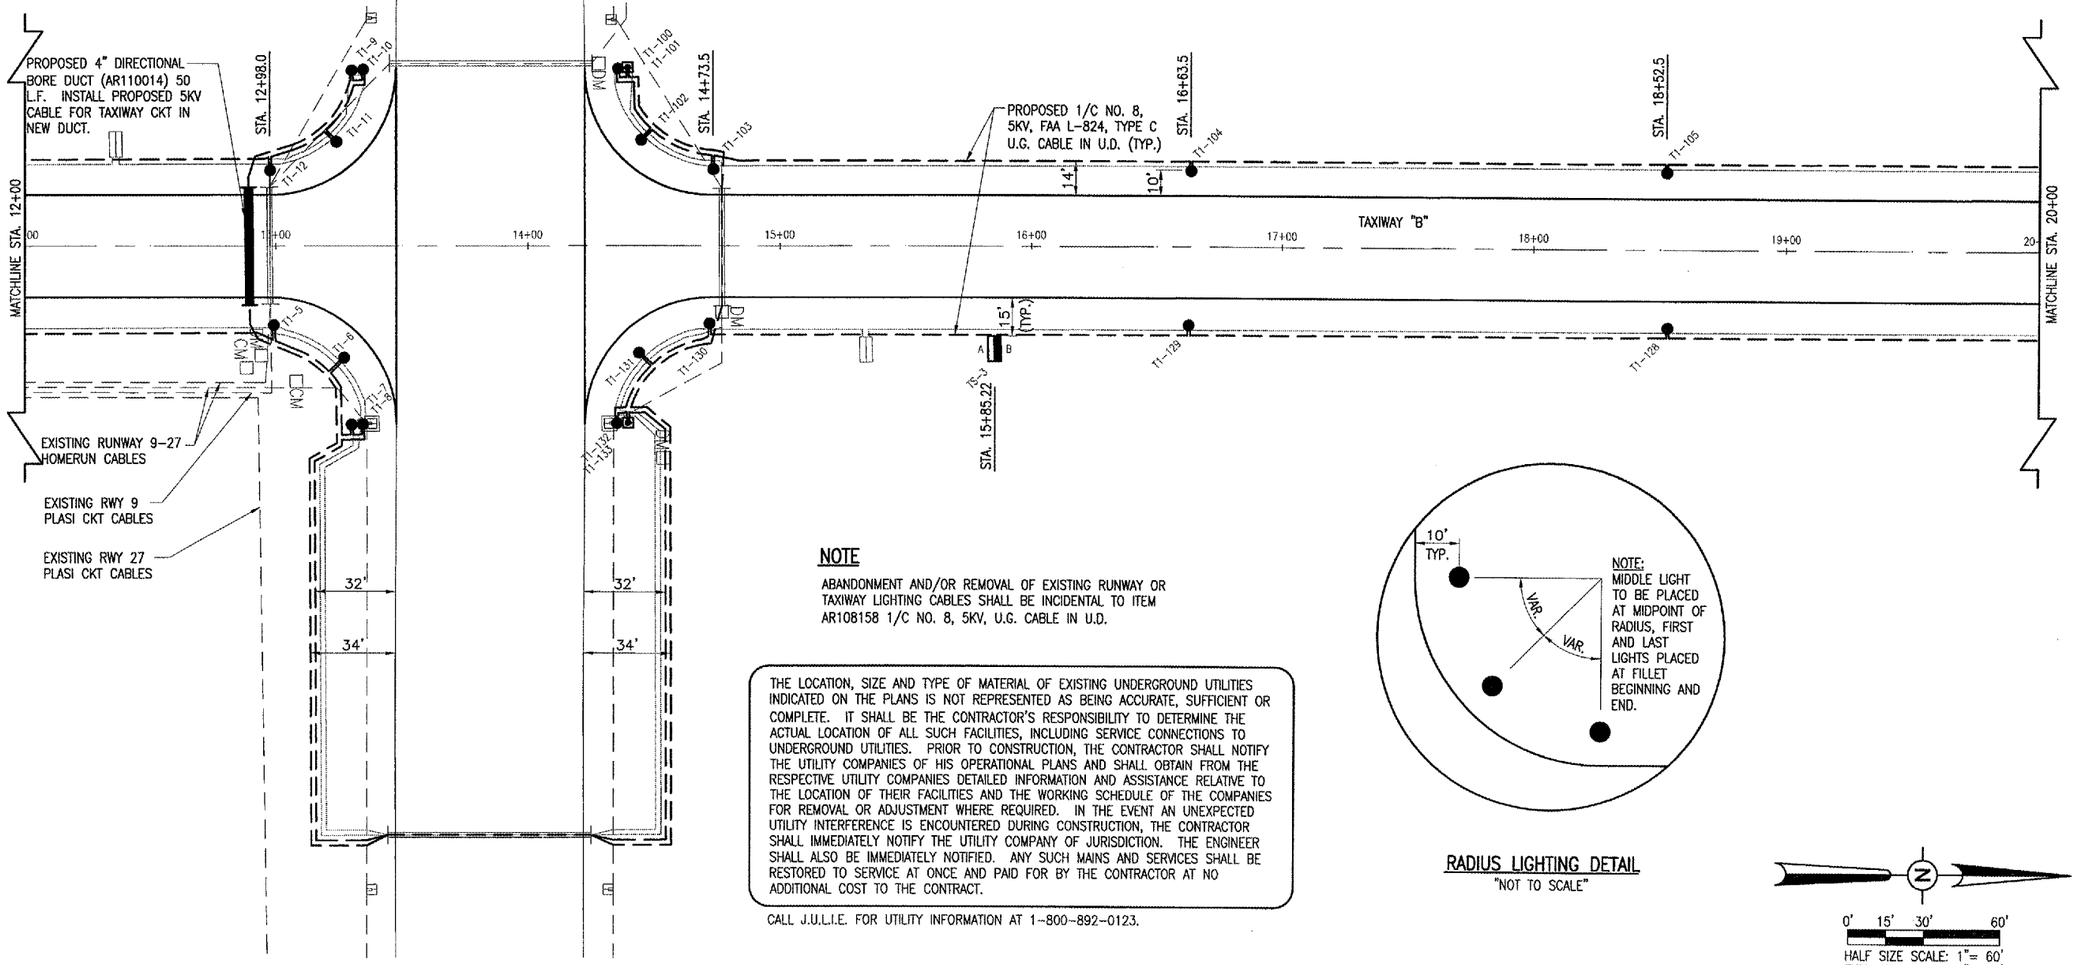

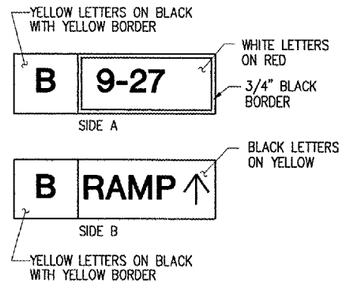

TAXIWAY GUIDANCE SIGN
TS-2 DETAIL
"NOT TO SCALE"

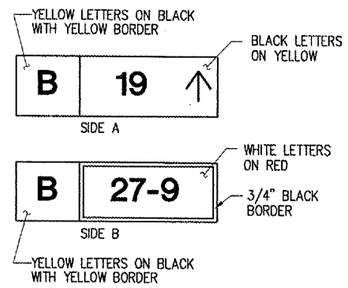

TAXIWAY GUIDANCE SIGN
TS-3 DETAIL
"NOT TO SCALE"

LEGEND

- EXISTING PAVEMENT
- EXISTING ELECTRICAL CABLES
- EXISTING ELECTRICAL DUCT
- PROPOSED IMPROVEMENTS
- PROPOSED ELECTRICAL DUCT
- PROPOSED 1/C NO. 8, 5KV, U.G. CABLE IN U.D.
- DM EXISTING DUCT MARKERS
- CM EXISTING CABLE MARKERS
- EXISTING STAKE MOUNTED RUNWAY LIGHT
- EXISTING BASE MOUNTED RUNWAY LIGHT
- PROPOSED STAKE MOUNTED TAXIWAY LIGHT
- PROPOSED BASE MOUNTED TAXIWAY LIGHT
- PROPOSED TAXI GUIDANCE SIGN

NOTE

ABANDONMENT AND/OR REMOVAL OF EXISTING RUNWAY OR TAXIWAY LIGHTING CABLES SHALL BE INCIDENTAL TO ITEM AR108158 1/C NO. 8, 5KV, U.G. CABLE IN U.D.

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

NOTE:
MIDDLE LIGHT TO BE PLACED AT MIDPOINT OF RADIUS, FIRST AND LAST LIGHTS PLACED AT FILLET BEGINNING AND END.

RADIUS LIGHTING DETAIL
"NOT TO SCALE"

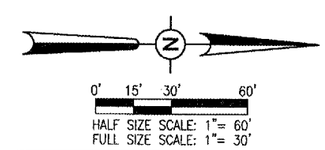

DATE	REVISION	BY

KEWANEE MUNICIPAL AIRPORT
KEWANEE, HENRY COUNTY, ILLINOIS

IL. PROJ.: EZI-3533 A.I.P. PROJ.: 3-17-0058-B10

HEI Project No. 810-06TXYD 0800
Filename R-142ELE.DWG
Scale 1"=30'
Date 08/02/05

LAYOUT	R.A.W.	08/02/05
DRAWN	B.A.K.	08/02/05
REVIEWED	C.A.H.	04/27/06

HANSON

Hanson Professional Services Inc.
3125 Dandy Trail, Suite 100
Indianapolis, Indiana 46214
Offices Nationwide

OVERLAY TAXIWAYS AND APRON

PROPOSED ELECTRICAL PLAN
STA. 12+00 TO STA. 20+00

I:\AIRPORTS\KEWANEE\810-06TXYD\AIRPORT\SHEETS-SPLIT\R-142ELE.DWG - STA. 12+00 TO STA. 20+00